

## PalComunale

### Dispersioni strutture opache

Cod.	Tipo	Descrizione	U [W/m²K]	T° esterna [°C]	Sup. Tot. [m²]	FT [W]	%	Sup. Parziali [m²]
M1	T	1 E Muro rivestim pietra 55cm	1,285	-14	178,98	8480	4,7	Pareti e porte opache  1527,82
M2	T	2 E SOTTOFIN rivestim pietra 55cm	1,595	-14	142,48	8593	4,8	
M3	T	3 E Muro rivestim PARAMANO 52cm	1,336	-14	536,05	27137	15,1	
M5	T	5 E Muro rivestim INTONACO 52cm	1,303	-14	145,75	7373	4,1	
M6	T	6 E SOTTOFIN rivestim INTONACO 52cm	1,623	-14	15,2	947	0,5	
M7	T	7 E Muro mansardato	0,94	-14	170,86	6080	3,4	
M8	T	8 E Muro rivestim INTONACO 22cm su ESTERNO	1,394	-14	40,43	2274	1,3	
M9	U	9 E Muro rivestim INTONACO 22cm su LNR	1,238	-0,4	171,14	4323	2,4	
M10	T	10 E Cassonetto	2,344	-14	106,56	9459	5,3	
M11	U	11 E REI su LNR	0,859	-0,4	14,49	254	0,1	
M12	U	12 E Porta legno su LNR	1,852	-0,4	2,52	95	0,1	
M13	U	13 E porta ferro su LNR	3,846	-0,4	3,36	264	0,1	

Cod.	Tipo	Descrizione	U [W/m²K]	T° esterna [°C]	Sup. Tot. [m²]	FT [W]	%	Sup. Parziali [m²]
P1	U	1 E Pavim su LNR	1,349	-0,4	582,17	16017	8,9	Pavimenti
P2	T	2 E Pavimento 1°p su esterno	1,635	-14	121,06	6731	3,8	703,23

Cod.	Tipo	Descrizione	U [W/m²K]	T° esterna [°C]	Sup. Tot. [m²]	FT [W]	%	Sup. Parziali [m²]
S1	T	1 E Tetto	0,967	-14	657,11	21605	12,1	Coperture  702,22
S2	T	2 E Soffitto piano su esterno	1,843	-14	17,12	1073	0,6	
S3	U	3 E Soffitto piano su LNR	1,66	-0,4	27,99	948	0,5	

<b>TOTALE OPACO</b>	<b>2.933,27</b>
---------------------	-----------------


### Dispersioni componenti finestrati

Cod.	Tipo	Descrizione	U [W/m²K]	T° esterna [°C]	Sup. Tot. [m²]	FT [W]	%
W1	T	1 E 150x280 AL VD	4,135	-14	4,2	590	0,3
W2	T	2 E 150x150 L VD	2,904	-14	148,5	16372	9,1
W3	T	3 E 150x150 L VS	4,819	-14	22,5	3779	2,1
W4	T	4 E 360x190 AL VS	5,778	-14	6,84	1344	0,7
W5	T	5 E 200x290 AL VS	5,807	-14	5,8	1260	0,7
W6	T	6 E 280x190 AL VS	5,783	-14	26,6	6014	3,4
W7	T	7 E 180x290 AL VS	5,8	-14	5,22	1184	0,7
W8	T	8 E 270x190 PVC VD	2,749	-14	30,78	3332	1,9
W9	T	9 E 180x190 PVC VD	2,729	-14	3,42	381	0,2
W10	T	10 E 350x290 AL VS	5,801	-14	10,15	2402	1,3
W11	T	11 E 150x130 PVC VD be	2,376	-14	5,85	567	0,3
W12	T	12 E 135x300 AL VS	5,807	-14	16,2	3518	2
W13	T	13 E 80x150 L VD	3,028	-14	22,8	2650	1,5
W14	T	14 E 150x300 AL VS	5,803	-14	36	8346	4,7
W15	T	15 E 150x250 L VD	2,93	-14	22,5	2484	1,4
W16	T	16 E 100x250 L VD	1,899	-14	12,5	904	0,5
W17	T	17 E 150x150 PVC VD	2,748	-14	18	1976	1,1
W18	T	18 E 150x250 PVC VD	2,781	-14	3,75	426	0,2
W19	T	19 E 70x130 L VD	2,831	-14	0,91	96	0,1

<b>TOTALE TRASPARENTE</b>	<b>402,52</b>
---------------------------	---------------

<b>TOTALE INVOLUCRO DISPERDENTE</b>	<b>3.335,79</b>
-------------------------------------	-----------------

<b>TOTALE INVOLUCRO DISPERDENTE su Esterno</b>	<b>2.534,12</b>
--	-----------------

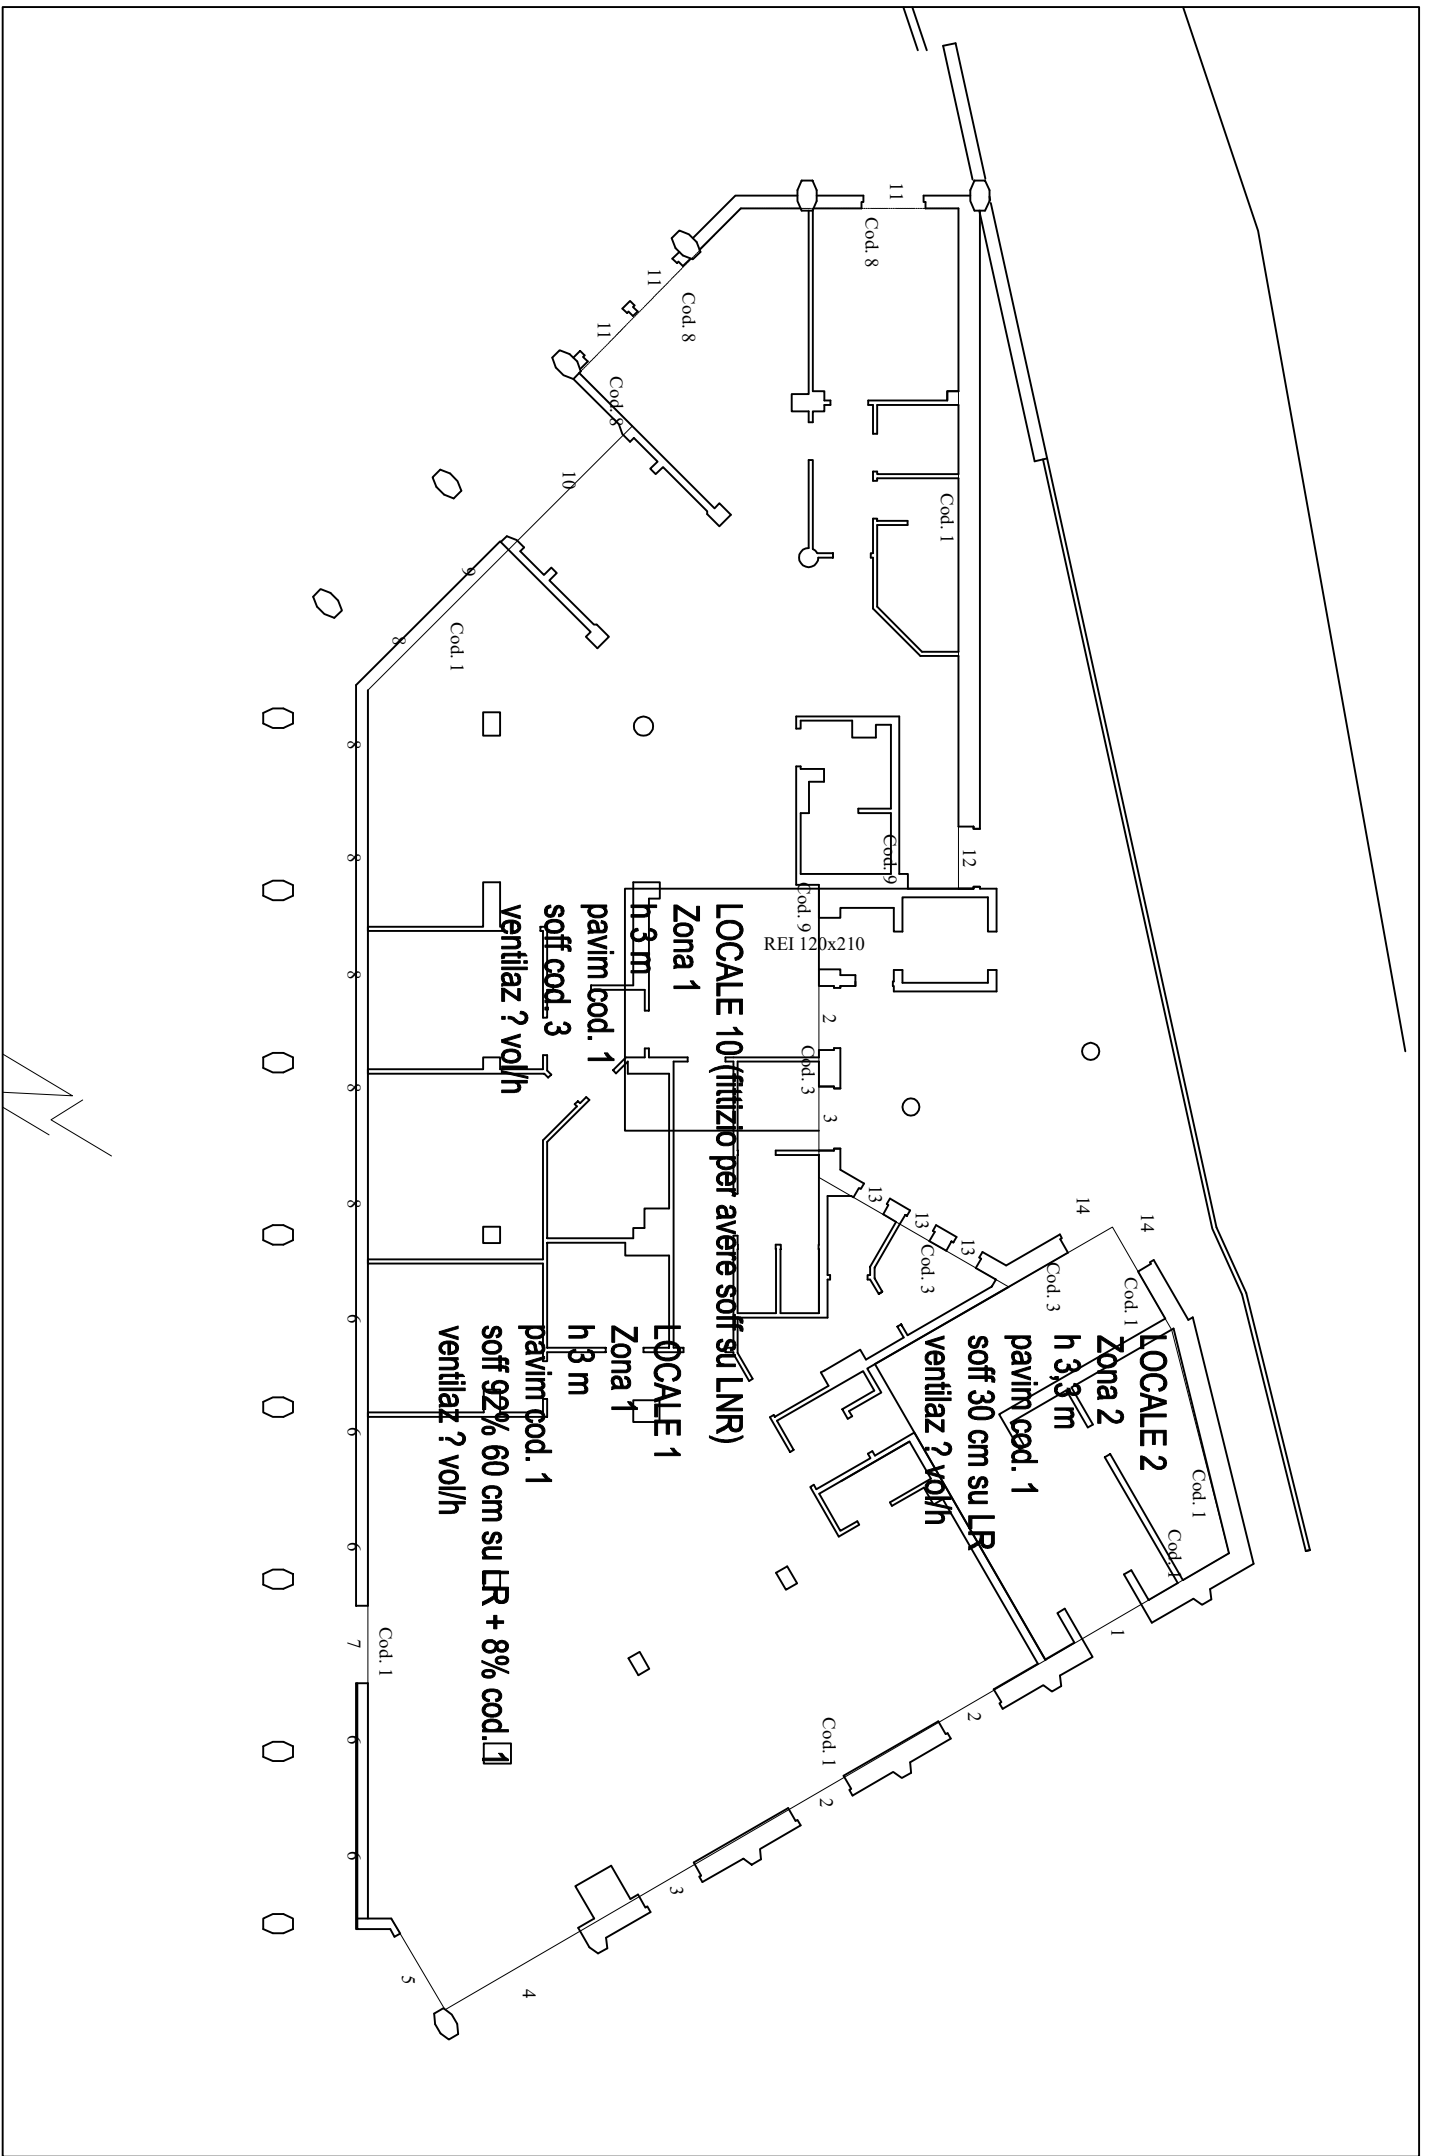

**LOCALE 10 (finitizo per avere soff su LNR)**

**Zona 1**

h 3 m

pavim bod. 1

soff cod. 3

ventilaz ? vol/h

**LOCALE 1**

**Zona 1**

h 3 m

pavim bod. 1

soff 92% 60 cm su ER + 8% cod. 1

ventilaz ? vol/h

**LOCALE 2**

**Zona 2**

h 3,3 m

pavim bod. 1

soff 30 cm su LR

ventilaz ? vol/h

REI 120x210

